

Security Cables



Caleb Cable offers a complete series of cables for alarm, security and CCTV applications.

Alarm Cables are used for the wiring of burglar alarms and other low voltage circuits.

Fire Alarm Cables, which are UL listed, are for application of fire alarm, smoke detectors, signaling and fire protective circuits.

FireTech (Fire Resistant Cable) is for fixed installation typically in fire alarm and emergency lighting circuits where circuit integrity must be maintained and installation where fire, smoke emission and toxic fumes create a potential threat to life and equipment.

For CCTV application, we offer a series of coax cables, composite cables (both for signal and power in one cable) and IPTV cables.

Security Cables

| Description | Page |
|---------------------------|------|
| Fire Test Standard | 5.3 |
| Certificate | 5.5 |
| Alarm Cable..... | 5.6 |
| Fire Alarm Cable..... | 5.7 |
| Fire Resistant Cable..... | 5.8 |
| IPTV Cable..... | 5.9 |
| CCTV Coax Cable | 5.11 |
| CCTV Composite Cable..... | 5.12 |

Fire Test Standard

BS6387:1994-Fire

Fire with Water and Fire with Mechanical Shock Test

The following test is the internationally recognized UK test used to determine if a cable is capable of maintaining circuit integrity under fire conditions, fire with water and fire with mechanical shock. These tests use a number of alternative time and temperature parameters and depending on the level achieved by the cable, a corresponding letter is assigned to denote the category the cable passed.

| Resistance to fire: | Symbol |
|-----------------------|--------|
| 650 °C for 3 hours | A |
| 750 °C for 3 hours | B |
| 950 °C for 3 hours | C |
| 950 °C for 20 minutes | S |

| Resistance to fire and water: | Symbol |
|--|--------|
| 650 °C for 15 minutes, then for 15 minutes with fire and water | W |

| Resistance to fire with mechanical shock: | Symbol |
|--|--------|
| 650 °C for 15 minutes with 30 seconds hammer blows | X |
| 750 °C for 15 minutes with 30 seconds hammer blows | Y |
| 950 °C for 15 minutes with 30 seconds hammer blows | Z |



Fire Test Standard

IEC60754 - Acid Gas Emissions Test

Due to concerns regarding the amount of acid gas, which can be produced when cables are burnt, this international test determines the amount of gas evolved by burning cables.

The recommended values of the test state that the weighted pH value should not be less than 4.3, when related to 1 liter of water and the weighted value of conductivity should not exceed 10 $\mu\text{s}/\text{mm}$.

IEC60332 Part 3 - Flame Propagation

This test defines the ability of bunched cables to restrict vertical flame propagation when laid in cable trays, or conduit.

The test comprises of 3 categories, each determined by the amount of combustible material in a 1 m sample.

IEC60331 - Fire Test

This international fire test is to establish whether a cable can maintain circuit integrity during and after exposure to fire. A sample is exposed to fire for 3 hours at a temperature of between 750 °C and 800 °C, after 3 hours the fire is extinguished and the current is turned off. After a further 12 hours, the sample of cable is re-energised and must maintain circuit integrity.

IEC61034 - Smoke Density Test

This test measures the smoke emission from electric cables during fire. The test is carried out in a 3 m³ chamber where cable sample is subjected to fire.

The smoke emission and density are measured by transmission a beam of light across the inside of the chamber to a photoelectric cell which measures the amount of light received.

PH30 BS 8434-1:2003

The duration of the test shall be 30 min (15 min for the initial fire and impact phase followed by an additional 15 min for the fire, impact and water phase), during which the cable shall not reach the point of failure.


Conformity to this requirement shall qualify for a 30 min classification.

PH120 BS 8434-2:2003

The duration of the test shall be 120 min (60 min for the initial fire and impact phase followed by an additional 60 min for the fire, impact and water phase), during which the cable shall not reach the point of failure.

Conformity to this requirement shall qualify for a 120 min classification.

Certificate

 **ONLINE CERTIFICATIONS DIRECTORY**

HNIR.E334180
Power-limited Fire Alarm Cable

[Page Bottom](#)

Power-limited Fire Alarm Cable

[See General Information for Power-limited Fire Alarm Cable](#)

| | |
|--|---------|
| CALEB CABLE INDUSTRIAL LTD ROOM 806 LANDMARK NORTH 39 LUNG SUM AVE SHEUNG SHUI N T, HONG KONG | E334180 |
|--|---------|

Type(s) FPLR

[Last Updated](#) on 2013-03-11

[Questions?](#)[Print this page](#)[Terms of Use](#)[Page Top](#)

◆ 2014 UL LLC

When the UL Leaf Mark is on the product, or when the word "Environment" is included in the UL Mark, please search the [UL Environment database](#) for additional information regarding this product's certification.

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2014 UL LLC".

Alarm Cable



Technical data

- **Temperature range:** -20 °C to 80 °C
- **Rated voltage:** 300 V
- **Min. insulation resistance:** 200 MOhm x km
- **Test voltage:** 1200 V
- **Minimum bending radius:** 10 x cable diameter

Cable structure

- Inner Conductor: TCCA
- Insulation: PVC
- Screen (optional): Al-PET + drain wire
- Sheath: PVC/LSF

Application

The flexible alarm cable is used for the wiring of burglar alarms and other low voltage circuits.

Cables without screen

| NO. of Cores | No. of cores x mm ² | Sheath Thickness mm | Outer Diameter mm |
|--------------|--------------------------------|---------------------|-------------------|
| 4C | 4 x 0.22 | 0.45 | 3.4 |
| 6C | 6 x 0.22 | 0.45 | 4.0 |
| 8C | 8 x 0.22 | 0.45 | 4.2 |
| 10C | 10 x 0.22 | 0.6 | 5.0 |
| 18C | 18 x 0.22 | 0.6 | 5.4 |
| 20C | 20 x 0.22 | 0.8 | 7.3 |
| 30C | 30 x 0.22 | 0.5 | 8.0 |
| 2C + 2C | 2 x 0.5 + 2 x 0.22 | 0.5 | 4.1 |
| 2C + 4C | 2 x 0.5 + 4 x 0.22 | 0.5 | 4.8 |
| 2C + 6C | 2 x 0.5 + 6 x 0.22 | 0.5 | 5.2 |
| 2C + 8C | 2 x 0.5 + 8 x 0.22 | 0.6 | 5.8 |
| 2C + 10C | 2 x 0.5 + 10 x 0.22 | 0.6 | 6.0 |
| 2C + 12C | 2 x 0.5 + 12 x 0.22 | 0.8 | 6.2 |

Cables with screen

| NO. of Cores | No. of cores x mm ² | Sheath Thickness mm | Outer Diameter mm |
|--------------|--------------------------------|---------------------|-------------------|
| 6C | 6 x 0.22 | 0.45 | 4.4 |
| 8C | 8 x 0.22 | 0.45 | 4.6 |

Fire Alarm Cable



Technical data

- **Temperature range:** -40 °C to +105 °C
- **Max. rated voltage-UL:** 300 V RMS
- **Minimum bending radius**
10x cable diameter

Cable structure

- Conductor: solid bare copper
- PVC core insulation: 2 cores
- Insulation color: black and red
- Optional screen: Al-PET and drain wire
- PVC Sheath (Red)

Certificate

- UL Approval: UL1424 Power-Limited Fire-Alarm Circuit Cable, Type FPLR, rated 60, 75, 90 or 105°C.
- UL File Number: E334180

Application

The power limited fire alarm and communications cable is used for the wiring of fire alarm, smoke detectors, signaling, and fire protective circuits.

| Conductor Diameter mm | AWG-no. | Outer Diameter mm | Copper Weight kg/km | Cable Weight kg/km | Max. Conductor Resistance Ohm/km |
|-----------------------|---------|-------------------|---------------------|--------------------|----------------------------------|
| 1.02 | 18 | 5.9 | 18.2 | 47.9 | 22.0 |
| 1.29 | 16 | 6.1 | 27.1 | 58.4 | 14.5 |
| 1.63 | 14 | 7.8 | 50.0 | 96.2 | 9.1 |
| 2.05 | 12 | 8.7 | 72.3 | 128.7 | 5.5 |

Fire Resistant Cable



Technical data

- **Temperature range:** -40 °C to 90 °C
- **Rated voltage:** 300/500 V
- **Test voltage:** 5000 V
- **Minimum bending radius:**
6 x cable diameter

Cable structure

- Plain annealed copper solid (1.0 - 2.5 mm²) or stranded (4.0 mm²) complying with B6360 class 1 or class 2.
- Insulation: Silicone rubber
- Screen: Al-PET foil + drain wire
- Sheath: LSOH

Standard


- BS 7629-1
- BS 6387 CWZ
- BS 5839-1 CLAUSE 26.2
- BS EN 50200 PH 30
- BS 8434-1

Application

The fire resistant cable is for fixed installation in fire alarm and emergency lighting circuits where circuit integrity must be maintained; its low smoke and zero halogen features makes it suitable for installation where fire, smoke emission and toxic fumes create a potential threat to life and equipment.

| NO. of Cores | Cross Section mm ² | Conductor Construction NO. x mm | Outer Diameter mm | Max. Conductor Resistance Ohm/km |
|--------------|-------------------------------|---------------------------------|-------------------|----------------------------------|
| 2 | 1.0 | 1/1.13 | 8.0 | 18.1 |
| 2 | 1.5 | 1/1.38 | 8.1 | 12.1 |
| 2 | 2.5 | 1/1.78 | 9.5 | 7.4 |
| 2 | 4.0 | 7/0.85 | 11.6 | 4.6 |
| 3 | 1.0 | 1.1.13 | 8.2 | 18.1 |
| 3 | 1.5 | 1/.138 | 8.4 | 12.1 |
| 3 | 2.5 | 1/1.78 | 10.4 | 7.4 |
| 3 | 4.0 | 7/0.85 | 12.3 | 4.6 |
| 4 | 1.0 | 1/1.13 | 8.5 | 18.1 |
| 4 | 1.5 | 1/1.38 | 10 | 12.1 |
| 4 | 2.5 | 1/1.78 | 11.9 | 7.4 |
| 4 | 4.0 | 7/0.85 | 13.5 | 4.6 |

IPTV Cable

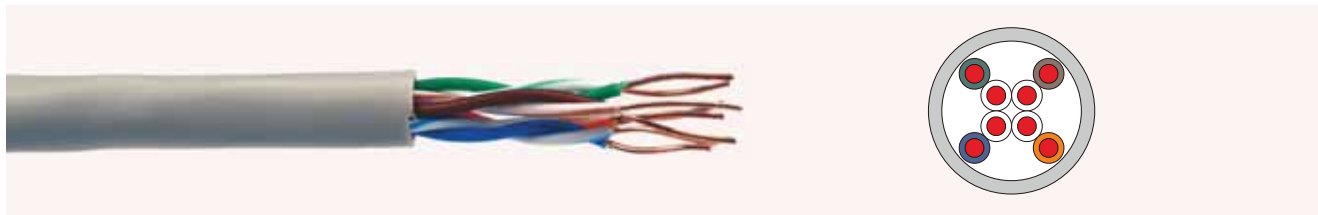

Technical Data

- **Temperature range:** -20 °C to 70 °C
- **Velocity ratio:** 69%
- **Characteristic impedance:** 100±15 Ohm
- **Min. bending radius :** 8 x cable diameter
- **Flame retardancy:** CMP, CMR, CMG, CM
- **UL File number is E334179**





Standards and performances

- IEC 61156-5 Edition 2.0
- EN 50288-3-1
- EIA/TIA 568-B.2 – Cat 5e
- ISO 11801 Edition 2 – CLASS D
- EN 50173 Edition 2 – CLASS D

Construction

Cat5e

| | |
|----------------------------|-------------------------------------|
| Conductor (dia.mm) | 24 AWG Solid bare copper 0.51 |
| Insulation (dia.mm) | HDPE 0.92 |
| Sheath (dia.mm) | PVC/LSOH 5.20 |
| No. of Pairs | 4 |

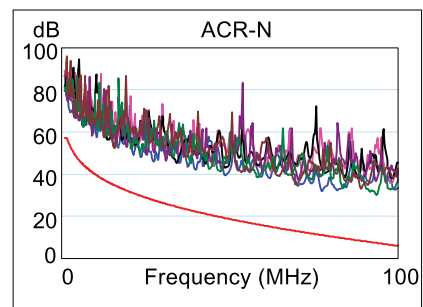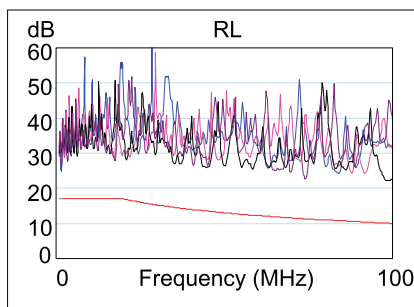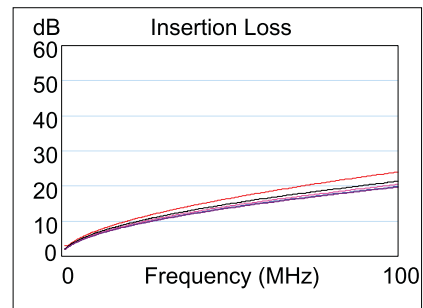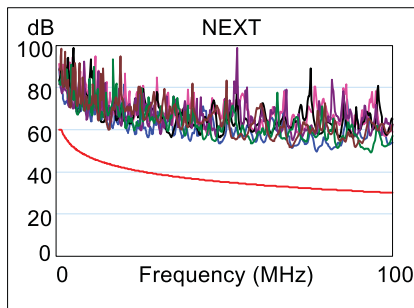

IPTV Cable







Technical Data

- **Temperature range:** -20 °C to 70 °C
- **Velocity ratio:** 72%
- **Characteristic impedance:**
(From 1 to 250 MHz) 100 ± 15 Ohm
- **Bending radius (min.):** 8 x cable diameter
- **Flame retardancy:** CMP, CMR, CMG, CM
- **UL File number is E334179**

Standards and performances

- IEC 61156-5 Edition 2.0
- EN 50288-5-1
- EIA/TIA 568-B.2-1 – Cat 6
- ISO 11801 Edition 2 – CLASS E
- EN 50173 Edition 2 – CLASS E

| Construction | Cat6 |
|----------------------------|----------------------------------|
| Conductor (dia.mm) | 23 AWG Solid bare copper 0.55 |
| Insulation (dia.mm) | Solid PE 1.02 |
| Filler | Cross member |
| Mylar Coverage(%) | $\geq 125\%$ |
| Drain wire | Tinned copper |
| Al-PET Shielded | $\geq 125\%$ |
| Sheath (dia.mm) | PVC/LSZH 7.20 |
| No. of Pairs | 4 |

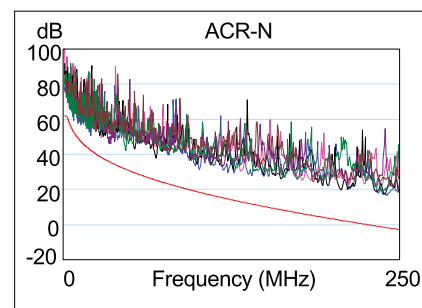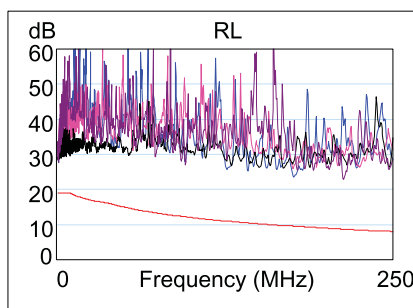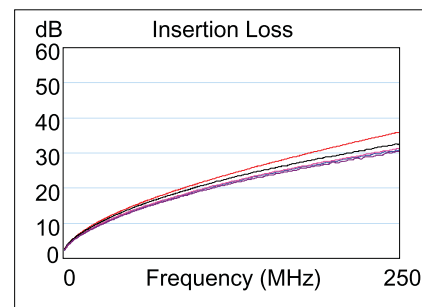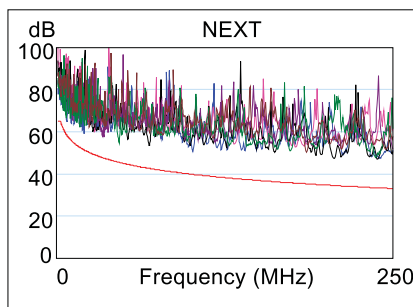

CCTV Coax Cable




Construction Data

| Cable code | | KX6 | KX6 (Long Distance) | KX8 |
|-----------------|----------|-------------|---------------------|-------------|
| Inner conductor | material | Bare copper | Bare copper | Bare copper |
| | dia. mm | 0.2 x 7 | 0.8 | 0.4 x 7 |
| Dielectric | material | Solid PE | Foam PE | Solid PE |
| | dia. mm | 3.70 | 3.7 | 7.25 |
| Screen: | | | | |
| Film foil type | material | ---- | Al-PET-Al(Bonded) | ---- |
| Foil coverage | % | ---- | > 100 | ---- |
| Braid material | | Bare copper | Tinned copper | Bare copper |
| Braid coverage | % | 80 | > 75 | 80 |
| Outer sheath | material | PVC | PVC | PVC |
| | dia. mm | 6.10 | 6.0 | 10.2 |

Electrical Data

| | | | | |
|----------------------------|---------|--------|--------|--------|
| Impedance | Ohm | 75 ± 3 | 75 ± 3 | 75 ± 3 |
| Capacitance | pF/m | 67 ± 2 | < 56 | 67 ± 2 |
| Velocity ratio | % | 66 | 83 | 66 |
| Attenuation (at 20°C) | | | | |
| at 50 MHz | dB/100m | 8.1 | ---- | 2.9 |
| at 100 MHz | dB/100m | 13.0 | 7.9 | 4.5 |
| at 200 MHz | dB/100m | 18.5 | 10.9 | 10.9 |
| at 450 MHz | dB/100m | 27.5 | ---- | 20.7 |
| at 800 MHz | dB/100m | 34.5 | 22.8 | 23.6 |
| at 860 MHz | dB/100m | 35.8 | ---- | 24.5 |
| at 1000 MHz | dB/100m | 45.0 | ---- | 27.5 |
| Inner conductor resistance | Ohm/km | 87.5 | 37 | 22.2 |

CCTV Composite Cable



Construction Data

| Cable code | | RG59 + 2 C | | RG59 + 4 C | |
|-----------------------|----------|-------------|-------------|-------------|-------------|
| | | A | B | A | B |
| Inner conductor | material | CCS | Bare copper | CCS | Bare copper |
| | dia. mm | 0.58 | 0.2 x 24 | 0.58 | 0.19 x 16 |
| Dielectric | material | Solid PE | PVC | Solid PE | PVC |
| | dia. mm | 3.70 | 2.0 | 3.70 | 1.8 |
| Screen: | | | | | |
| Braid material | | Bare copper | Chalk | Bare copper | Chalk |
| Braid coverage | % | 84 | ---- | 80 | ---- |
| Sheath | material | PVC | | PVC | PVC |
| | dia. mm | 6.10 | | 6.10 | 10.2 |
| Mylar spiral coverage | % | 115 | | 115 | PVC |
| Outer sheath | material | LSZH | | PVC | PVC |
| | dia. mm | 10.3 | | 9.8 | 10.2 |

Electrical Data

| | | | | | |
|----------------------------|----------|---------|-------|--------|-------|
| Impedance | Ohm | 75 ± 3 | | 75 ± 3 | |
| Capacitance | pF/m | >70 | | >70 | |
| Velocity ratio | % | 66 | | 66 | |
| Attenuation (at 20°C) | | | | | |
| at | 50 MHz | dB/100m | 8.5 | 8.5 | |
| at | 100 MHz | dB/100m | 11.8 | 11.8 | |
| at | 200 MHz | dB/100m | 16.5 | 16.5 | |
| at | 450 MHz | dB/100m | 26.0 | 26.0 | |
| at | 800 MHz | dB/100m | 35.8 | 35.8 | |
| at | 860 MHz | dB/100m | 37.2 | 37.2 | |
| at | 1000 MHz | dB/100m | 39.5 | 39.5 | |
| Inner conductor resistance | Ohm/km | 235 | <24.6 | 235 | <40.5 |